PRESSURE ZONE 297
FIRE FLOW 1,000 GPM

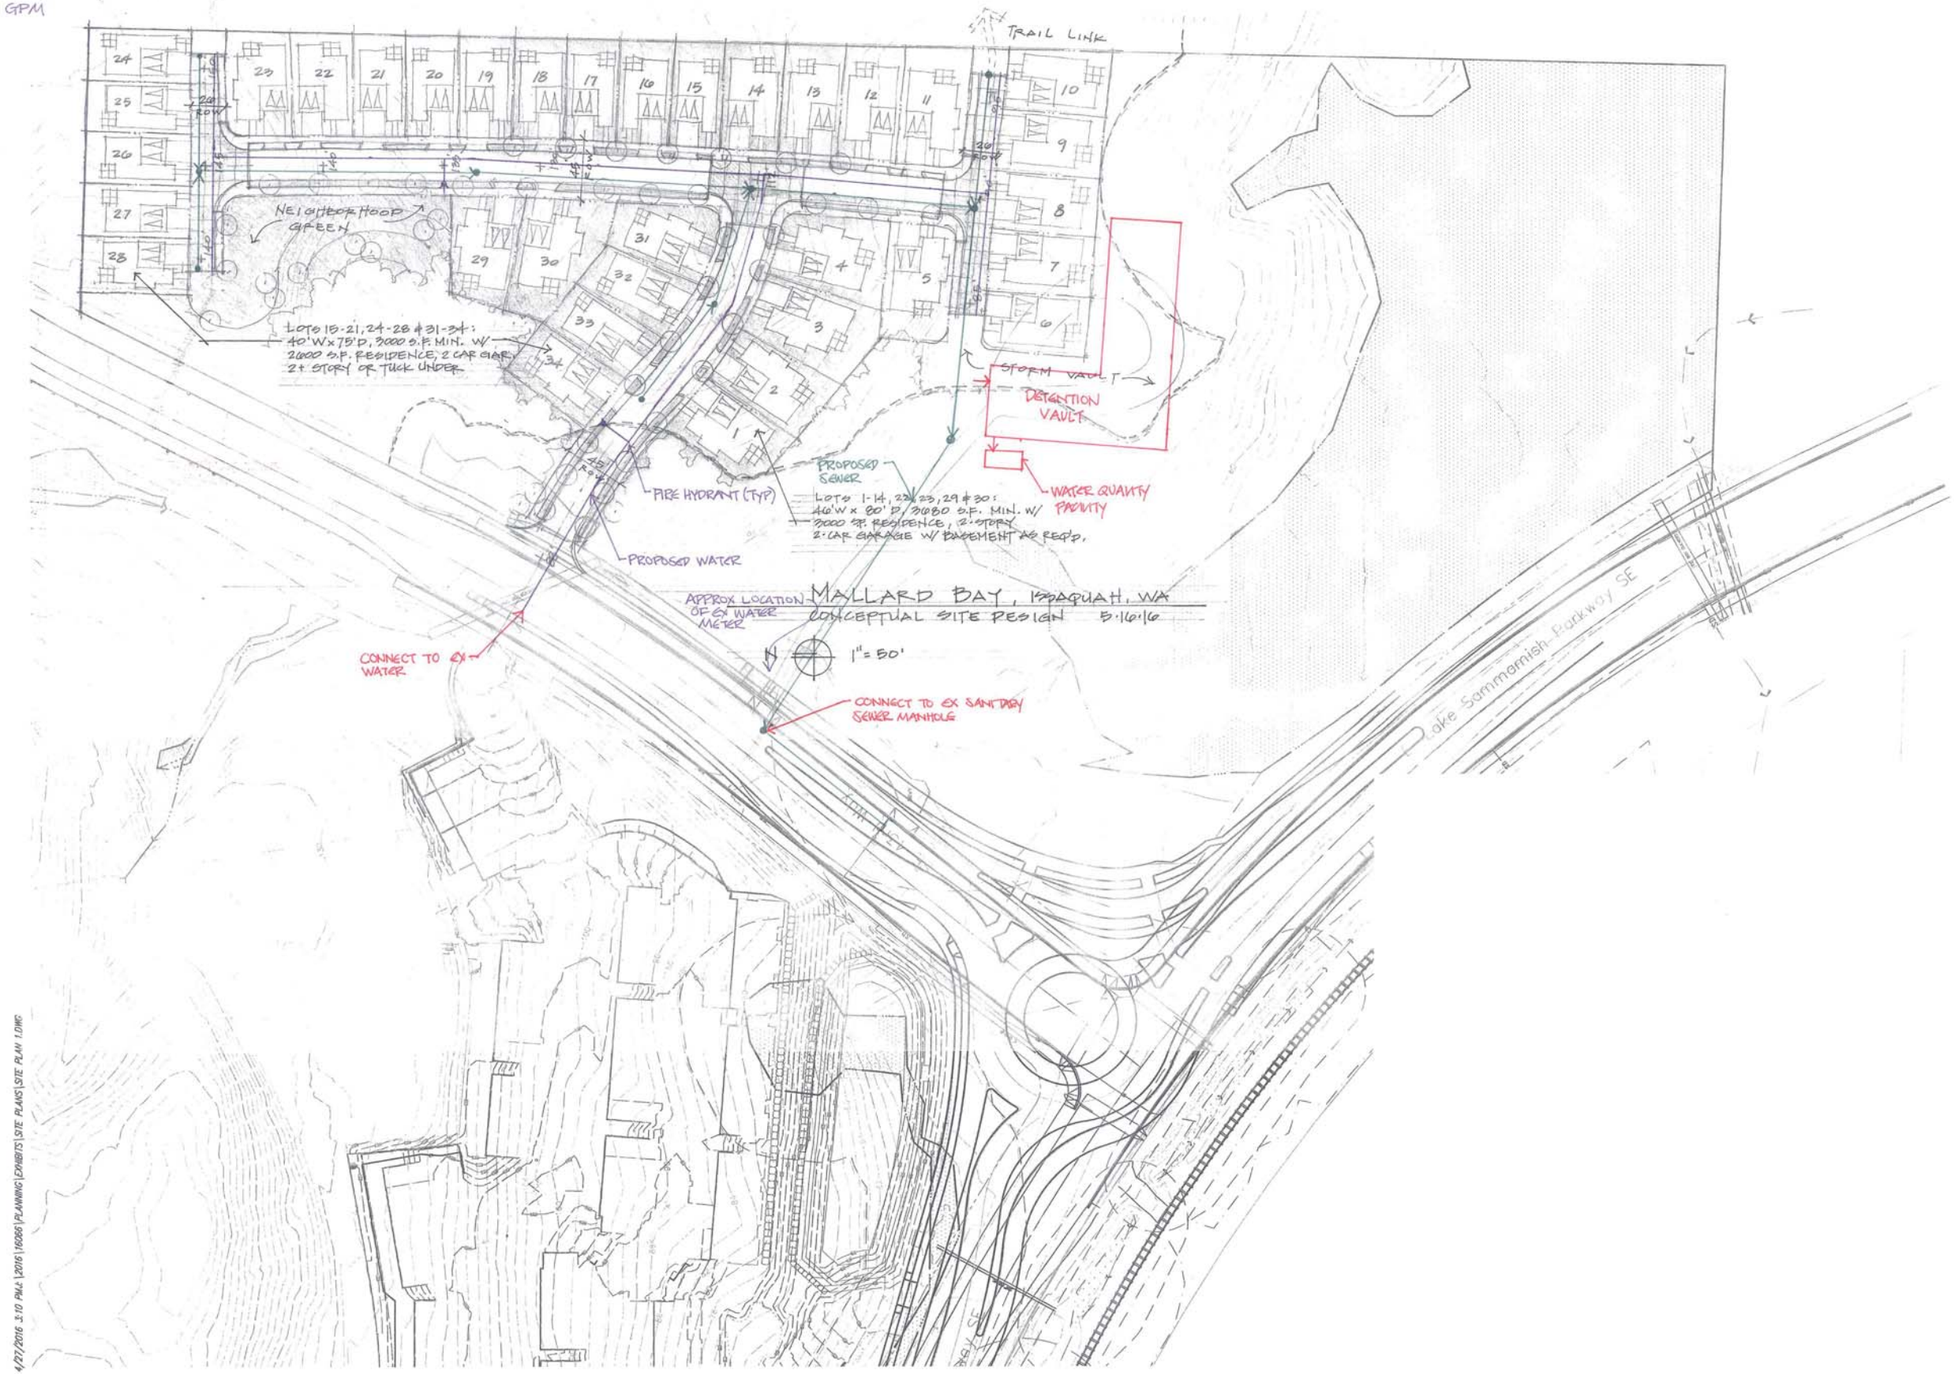

4/27/2016 3:10 PM L:\2016\16086\PLANNING\EXHIBITS\SITE PLANS\SITE PLAN 1.DWG